INSTALLATION GUIDE

LED BACKLIT PANEL

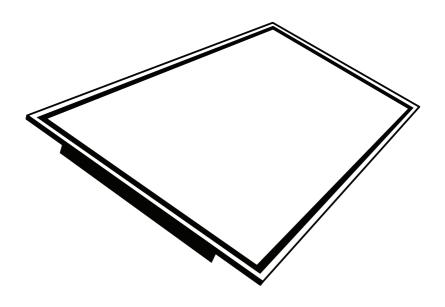


Table Of Contents

Safety Information	2
Pre-Installation	
Specifications	3
Drawing Dimensions	3
Mounting Options	4
Mounting Kit	4
Tools Required	4
Hardware Included	4
Before You Begin	4

Recessed Mount5
Making the Electrical Connections6
Mounting Accessories Installation8

Safety Information

IMPORTANT: THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE NATIONAL ELECTRICAL CODE AND LOCAL BUILDING CODES BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

SAVE THESE INSTRUCTIONS.



WARNING: Before installation or servicing, turn the power OFF at the circuit breaker or fuse. Place tape over the circuit breaker switch and verify power is OFF at the light fixture.



WARNING: Ground the fixture to avoid potential electric shock.



WARNING: Wear gloves when handling the fixture as edges are sharp.

CAUTION: Connect the fixture to a 120-277 Volt, 60 Hz power source. Any other connection voids the warranty.

NOTICE: FCC Regulations state that any unauthorized changes or modifications to this equipment not expressly approved by the manufacturer could void the user's authorization to operate this equipment.

IMPORTANT: The device is tested and found to comply with Part 15 of the FCC Rules. Operation is subject to two conditions: (1) This device may not cause harmful interference and, (2) this device must accept any interference received, including any interference that may cause undesired operation.

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment.

The equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.


Pre-Installation

Specifications

Voltage 120-277VAC, 58/60Hz				
Dimming	0-10VDC			
Operating Temperature Range	-20°C to 40°C (4°F to 104°F)			
Ceiling Type T-bar grid ceiling				
Light Source	Non-replaceable LED			

Drawing Dimensions

1x4

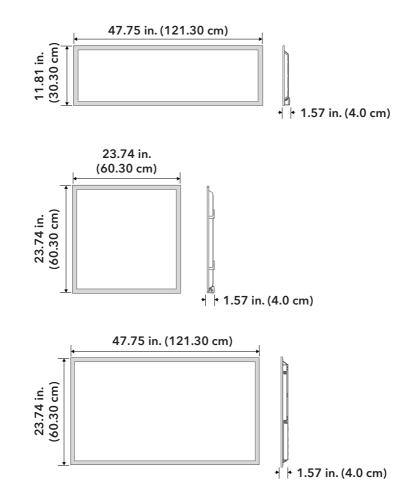


2x2

2x4


Mounting Options

Recessed




Mounting Kit Accessories

Surface (requires Mounting Kit)




Pendant/Suspension (requires Mounting Kit)



SUSPENSION MOUNT KITS				
SKU DISCRIPTION				
DP-PKT-12-S	2 CABLE SUSPENSION MOUNT KIT (FROM 0.6-3.9' LENGTH)			
DP-PKT-14-S	4 CABLE SUSPENSION MOUNT KIT (FROM 0.6-3.9' LENGTH)			

SURFACE MOUNT KITS			
SKU DESCRIPTION			
DP-SMF-22-W	2'X2' SURFACE MOUNT KIT		
DP-SMF-24-W 2'X4' SURFACE MOUNT KIT			

Tools Required

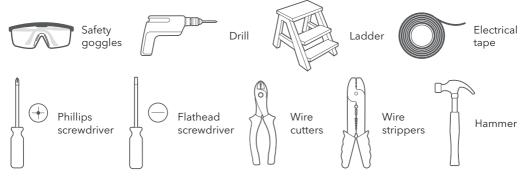

Hardware Included



AA - Wire nuts x5

Before You Begin

- 1. Turn off the electricity at the circuit breaker or fuse box.
- 2. Choose your installation option:
 - Installation Option 1 Recessed Mount
 - Installation Option 2 Surface Mount Kit (Sold Separately)
 - Installation Option 3 Pendant/Suspension Mount Kit (Sold Separately)


Installation Option 1 - Standard Recessed Mount

WARNING: Before you begin, turn the power off at the circuit breaker or fuse box to avoid electric shock.




Removing the ceiling panel

a. Remove the plasterboard panel from the ceiling.

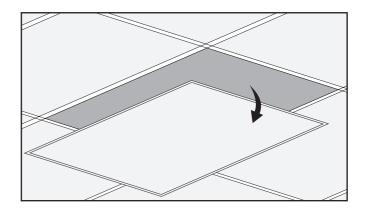


2 Connecting the wires

- a. Lift the fixture to the ceiling.
- b. Follow the steps in the **Making the Electrical Connections** section of this manual.

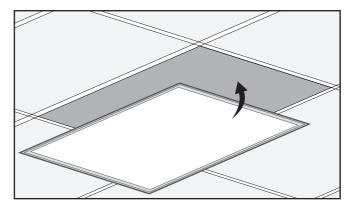

3 Completing the installation

- a. Slide the fixture into place in the ceiling.
- b. Attached earthquake clips to grid.
- c. Restore power to the fixture.

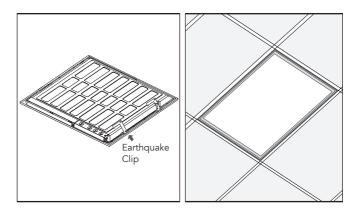


Making the Electrical Connections

WARNING: Before you begin, turn the power off at the circuit breaker or fuse box to avoid electric shock.


Open the junction box

a. Unscrew and remove the junction box cover (1) from the fixture.

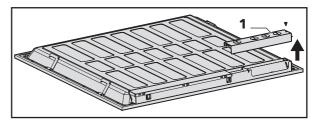

2 Connect the supply wires

- a. Connect the green ground wire from the fixture to the supply ground wire.
- b. Connect the white wire from the fixture to the supply white wire (neutral wire).
- c. Connect the black wire from the fixture to the supply black wire (live wire).
- d. Secure the three connections using three of the supplied wire nuts (AA).
- e. Wrap the three wire connections with electrical tape for a more secure connection (electrical tape not included).

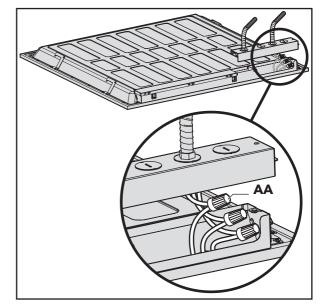


Making the Electrical Connections (continued)

3 Connect the dimming wires

- a. Connect the purple wire from the fixture to the purple (DIM+) supply wire.
- b. Connect the gray wire from the fixture to the gray (DIM-) supply wire.
- c. Secure the two connections using the remaining two supplied wire nuts (AA).
- d. Wrap the two wire connections with electrical tape for a more secure connection (electrical type not included).

4 Reinstall the junction box cover

- a. Position the wires back inside the junction box.
- b. Reinstall the junction box cover (1).

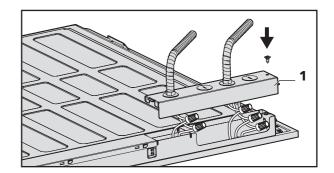


Requires Accessory Kit


SKU	DESCRIPTION		
DP-SMF-22-W	2'X2' SURFACE MOUNT KIT		
DP-SMF-24-W	2'X4' SURFACE MOUNT KIT		

KIT INCLUDES:


(Available for 2'x2' and 2'x4' versions only)


	Quantity			c.		
Parts List	2'x2'	2'x4'	Image	Size	Material	
Screw A (KS 1X10)	8	8	<u>Ĵ</u>	0.04 inches diameter, 0.40 inches length	Zinc Coated Iron	
Screw B (KA 4X25)	6	6	Ĵ	0.16 inches diameter, 0.98 inches length	Zinc Coated Iron	
Expansion Bolt	6	6		0.24 inches diameter, 1.18 inches length	PVC	
Frame	4	2		24.17 inches length, 2.44 inches height	Aluminum	
Frame	0	2		48.17 inches length, 2.44 inches height	Aluminum	





2. Fix the frame to the ceiling with Screw B fitting into Expansion Bolts.





Option 3: Suspension Mount Installation


Requires Accessory Kit

SKU	DISCRIPTION				
DP-PKT-12-S	2 CABLE SUSPENSION MOUNT KIT (FROM 0.6-3.9' LENGTH)				
DP-PKT-14-S	4 CABLE SUSPENSION MOUNT KIT (FROM 0.6-3.9' LENGTH)				


KIT INCLUDES:

(All kits compatible with all size Dream Panels)


Quantity			CABLE IMAGES				
Parts List	2'x2'	2'x4'	Image Size Material	iviateriai	DP-PKT-12 CABLE	DP-PKT-14 CABLE	
Screw B (KA 4X25)	2	2	Ĵ	0.16 inches diameter, 0.98 inches length	Zinc Coated Iron	Lower	T Lower
Expansion Bolt	2	2		0.24 inches diameter, 1.18 inches length	PVC	Cover	Cover
Upper Cover	2	2	Î	0.59 inches diameter, 0.67 inches height	Nickel Plated Copper	I VO	
Lower Cover	2	4	8	0.45 inches diameter	Zinc Coated Iron	Y	
Cable	2	4	See Cable Images	3.28 foot main cable, 2.30 foot branch cable	Stainless	Connector	
Connector	2	0	See Cable Images	0.35 inches diameter, 1.02 inches height	Stainless	E)	
Suspension Hook	4	4	See Cable Images	0.74 inches width, 1.30 inches height	Zinc Coated Iron		
Triangle Bracket	4	4		1.10 inches width, 1.18 inches total height	Zinc Coated Iron	Suspension Hook	Suspension Hook



1. Based on the length of the panel, drill two mounting holes on the mounting plane. (2 holes for 2-cable kit and 4 holes for 4-cable kit)



2. Fix the Upper Cover to mounting hole.




3. Insert Screw B into the Expansion Bolt to create a self-tapping screw.

7.




4. Use the self-tapping screw to secure the Upper Cover to the mounting hole.







6. Replace Earthquake Clips with Triangle Brackets (use existing screws to secure)



Release wire and attach Suspension Hooks to Triangle Brackets. Adjust wires to desired length.

5